

Evaluation Report "MPF-G" Fixed Blades Wall Louver

Manufacturer

Metallic Products Corporation

7777 Hollister Road
Houston, TX 77040

For

Florida Product Approval

FL 12256.1 R4

Florida Building Code 7th Edition (2020)

Method: 1 - D

Category: Panel Wall

Sub - Category: Wall Louver

Product Name: MPF-G Wall Louver
Material: Steel

This item has been electronically signed and sealed by James L. Buckner, P.E., on this date using a Digital Signature. Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.

Prepared by:


James L. Buckner, P.E., SECB
Florida Professional Engineer # 31242
Florida Evaluation ANE ID: 1916

Report No. 20-297.01_Louver-MPFG-ER

Date: 12 / 31 / 2020

Contents:

Evaluation Report Pages 1 – 6

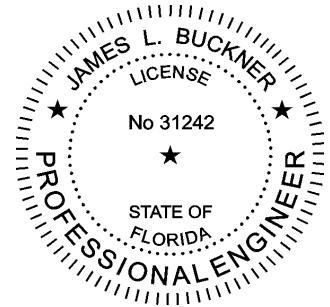

A handwritten signature in blue ink, appearing to read "James L. Buckner".

2020.12.31 13:21:32 -05'00'

Manufacturer:	Metallic Products Corporation 7777 Hollister Road Houston, TX 77040 (713) 856-9696 http://www.mpvent.com/
Product Name:	Fixed Blades Wall Louver MPF-G
Product Category:	Panel Walls
Product Sub-Category	Wall Louver
Compliance Method:	State Product Approval Rule 61G20-3.005 (1) (d)
Product Description:	Fixed Blades Wall Louvers are specifically designed to for pre- engineered metal wall panels. These systems are self-flashing and self-framing. Fixed Blades Wall louvers feature 45° roll-formed blades with 4" depth, and riveted to louver frame for security.
Product Assembly as Evaluated:	Refer to Page 4 of this report for product assembly components/materials & standards: <ol style="list-style-type: none">1. Wall Louver2. Fasteners
Support:	Type: Steel Sub-Framing (Design of support system is outside the scope of this evaluation) Description: <ul style="list-style-type: none">• Material: Steel• Thickness: 14 Gauge minimum• Yield Strength: 50 ksi minimum
Performance:	Wind Resistance * Allowable Design Pressure: +/- 116 PSF * Allowable design pressure for allowable stress design (ASD) Tested Impact Resistance <ul style="list-style-type: none">• Standard: ASTM E1886 (Large Missile Impact)• Assembly: As described in this evaluation report• Results: Pass• Missile Impact Level: D

- Performance Standards:** The following test protocols were performed to demonstrate compliance with the intent of the code as this product does not specifically address the performance standard in the code.
- ASTM E330-97 – *Standard Test Method for Structural Performance of Exterior Windows, Curtain Walls, and Doors and by Uniform Static Air Pressure Difference*
 - ASTM E1886-02 – *Standard Test Method for Performance of Building Envelope Impacted by Missile(s) and Exposed to Cyclic Pressure Differentials*
- Standards Equivalency:** The ASTM E330-97 & ASTM E1886-02 standard version used to test the evaluated product assembly is equivalent to ASTM E330-14 & ASTM E1886-12 standard version adopted by the Florida Building Code 7th Edition (2020).
- Code Compliance:** The product(s) described herein have demonstrated compliance with the performance standards listed above as referenced in the current Florida Building Code.
- Evaluation Report Scope:** This product evaluation demonstrates compliance of this product with the structural wind load requirements of the Florida Building Code, as related to Florida Product Approval Rule 61G20-3.001.
- Product Limitations and Conditions of Use:**
- Refer to applicable building code section for ventilation requirements.
 - Structural loads shall comply with the design provisions of the FBC 7th Edition (2020), Chapter 16, Section 1609.
 - This product has not been evaluated for wind driven rain resistance.
 - Impact rating is for the evaluated assembly as described in this report with no variance or modification.
- General Limitations and Conditions of Use:**
- Scope of “Limitations and Conditions of Use” for this evaluation:
This evaluation report for “Optional Statewide Approval” contains technical documentation, specifications and installation method(s) which include “Limitations and Conditions of Use” throughout the report in accordance with Rule 61G20-3.005. Per Rule 61G20-3.004, the Florida Building Commission is the authority to approve products under “Optional Statewide Approval”.
 - Option for application outside “Limitations and Conditions of Use”
Rule 61G20-3.005(1)(e) allows engineering analysis for “project specific approval by the local authorities having jurisdiction in accordance with the alternate methods and materials authorized in the Code”. Any modification of the product as evaluated in this report and approved by the Florida Building Commission is outside the scope of this evaluation and will be the responsibility of others.
 - This report is a building code product evaluation per FLPE rule (FAC) 61G15-36 to comply with Florida product approval rule (FAC) 61G20-3. This evaluation report is part of the Florida Building Commission approval for the listed code related criteria. This report by James Buckner, P.E. and CBUGK Engineering is not a design certification of code compliance construction submittal documentation, per FBC section 107, for any individual structure, site specific or permit design.
 - All metal components and fasteners shall be corrosion resistant in accordance with applicable sections of FBC, including but limited to Sections 1504.3.2, 1506.6 and 1507.4.4.
 - Design of support system is outside the scope of this report.
 - Fire Classification is outside the scope of Rule 61G20-3, and is therefore not included in this evaluation.
 - This evaluation report does not evaluate the use of this product for use in the High Velocity Hurricane Zone code section. (Dade & Broward Counties)

Quality Assurance:

The manufacturer has demonstrated compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity through **Architectural Testing, Inc. – QA** (FBC Organization #: QUA 1844)

**Component(s)/
Material Standards:**

Fixed Blades Wall Louver

Model Name: MPF-G
Overall Dimension: 48 " x 48" Maximum
Frame Component:
Material: Steel
Thickness: 18 gauge
Yield Strength: 50 ksi Minimum
Corrosion Resistance: G-90 Galvanized

Blade Component:
Material: Steel
Thickness: 20 gauge
Yield Strength: 50 ksi Minimum
Corrosion Resistance: G-90 Galvanized

Fastener

Type: Self-Drilling Screw w/ Weather-Seal Washer
Size: 1/4" – 14 x minimum penetration through support 3/4"
Head: Hex-Head
Material: Corrosion Resistance Steel
Standard: Per SAE J78-1979

Installation:

Installation Method:

(Refer to drawings at the end of this evaluation report.)

Attach Fixed Blades Wall Louvers model MPF-G to minimum 14 Ga. steel supports with 1/4" – 14 x minimum penetration through support 3/4 in.


- Locate Fasteners along the entire perimeter of the louver
- Fastener Spacing: 12 in. o.c. Maximum & 2 in. from each corner

The "Fixed Blades Wall Louvers" shall be installed in compliance with the installation method listed in this report. The installation method described herein is in accordance with the scope of this evaluation report. Refer to manufacturer's installation instructions as a supplemental guide for attachment.

Evaluated Referenced Data:


1. ASTM E330-97e1 Uniform Static Air Pressure Difference Test
By: Architectural Testing, Inc. – Test Lab (FBC Organization #TST ID: 1910)
Report Number: 61245.01-801-44, Dated: 12/14/05
ASTM E1886-02 Impact Test (Only)
By: Architectural Testing, Inc. – Test Lab (FBC Organization #TST ID: 1910)
Report Number: 61245.01-801-44, Dated: 12/14/05
2. Quality Assurance
By Architectural Testing, Inc. – QA, (FBC Organization #QUA ID:1844)
3. Certification of Independence
By James L. Buckner, P.E. @ CBUCK Engineering
(FBC Organization # ANE 1916)

Installation Method Metallic Products Fixed Blades (MPF-G) Wall Louver Attached to 14 Ga. Steel Supports

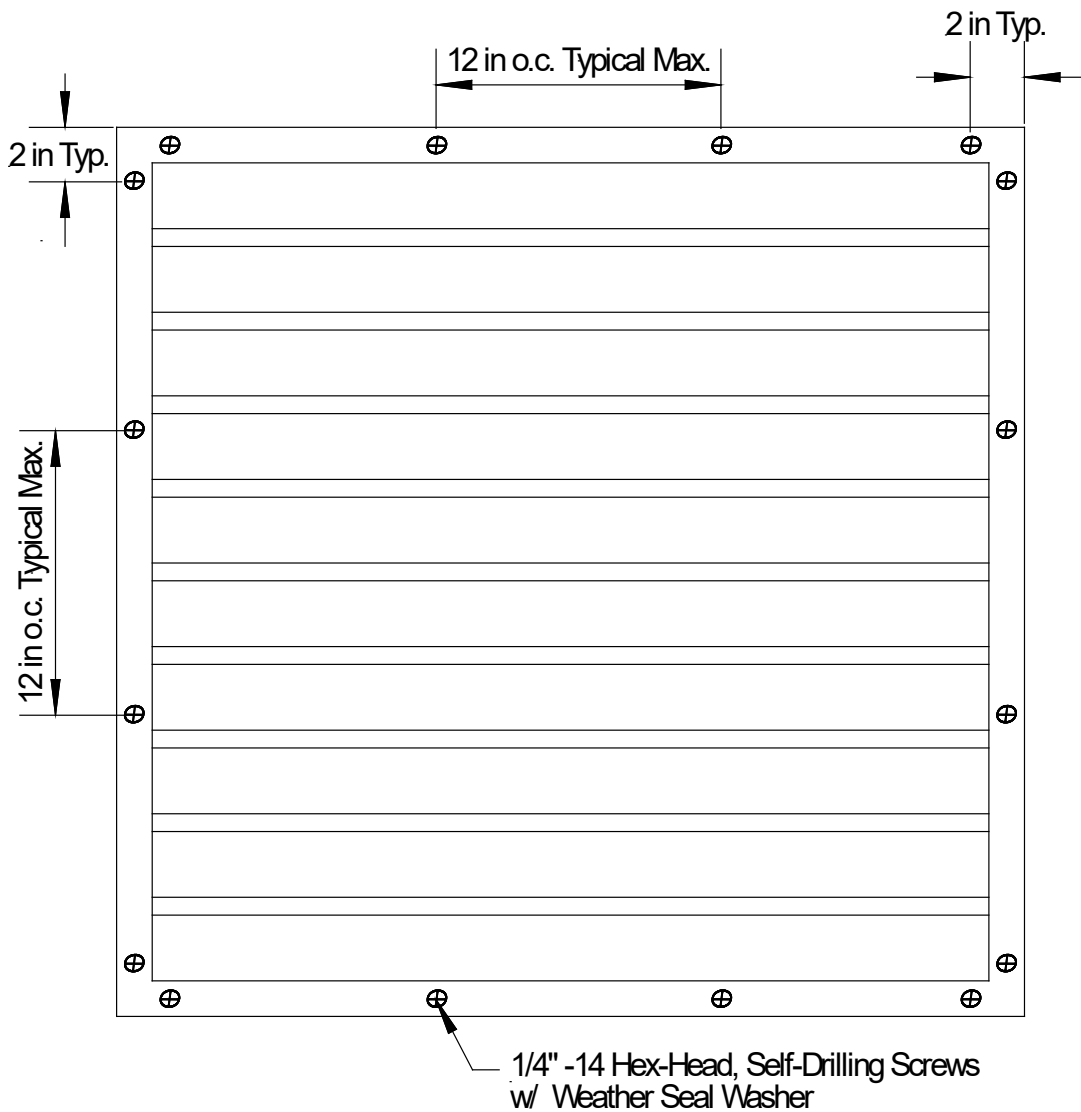

Front Elevation View

Installation Method
Metallic Products Corporation
Fixed Blades (MPF-G) Wall Louver
Attached to 14 Ga. Steel Supports

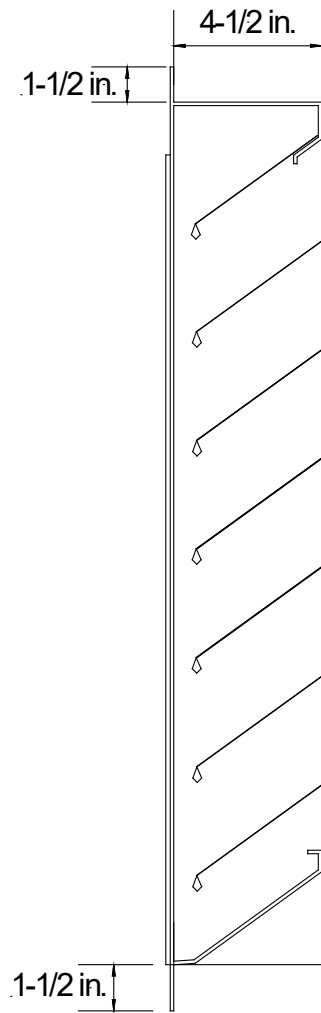

Side Section View